
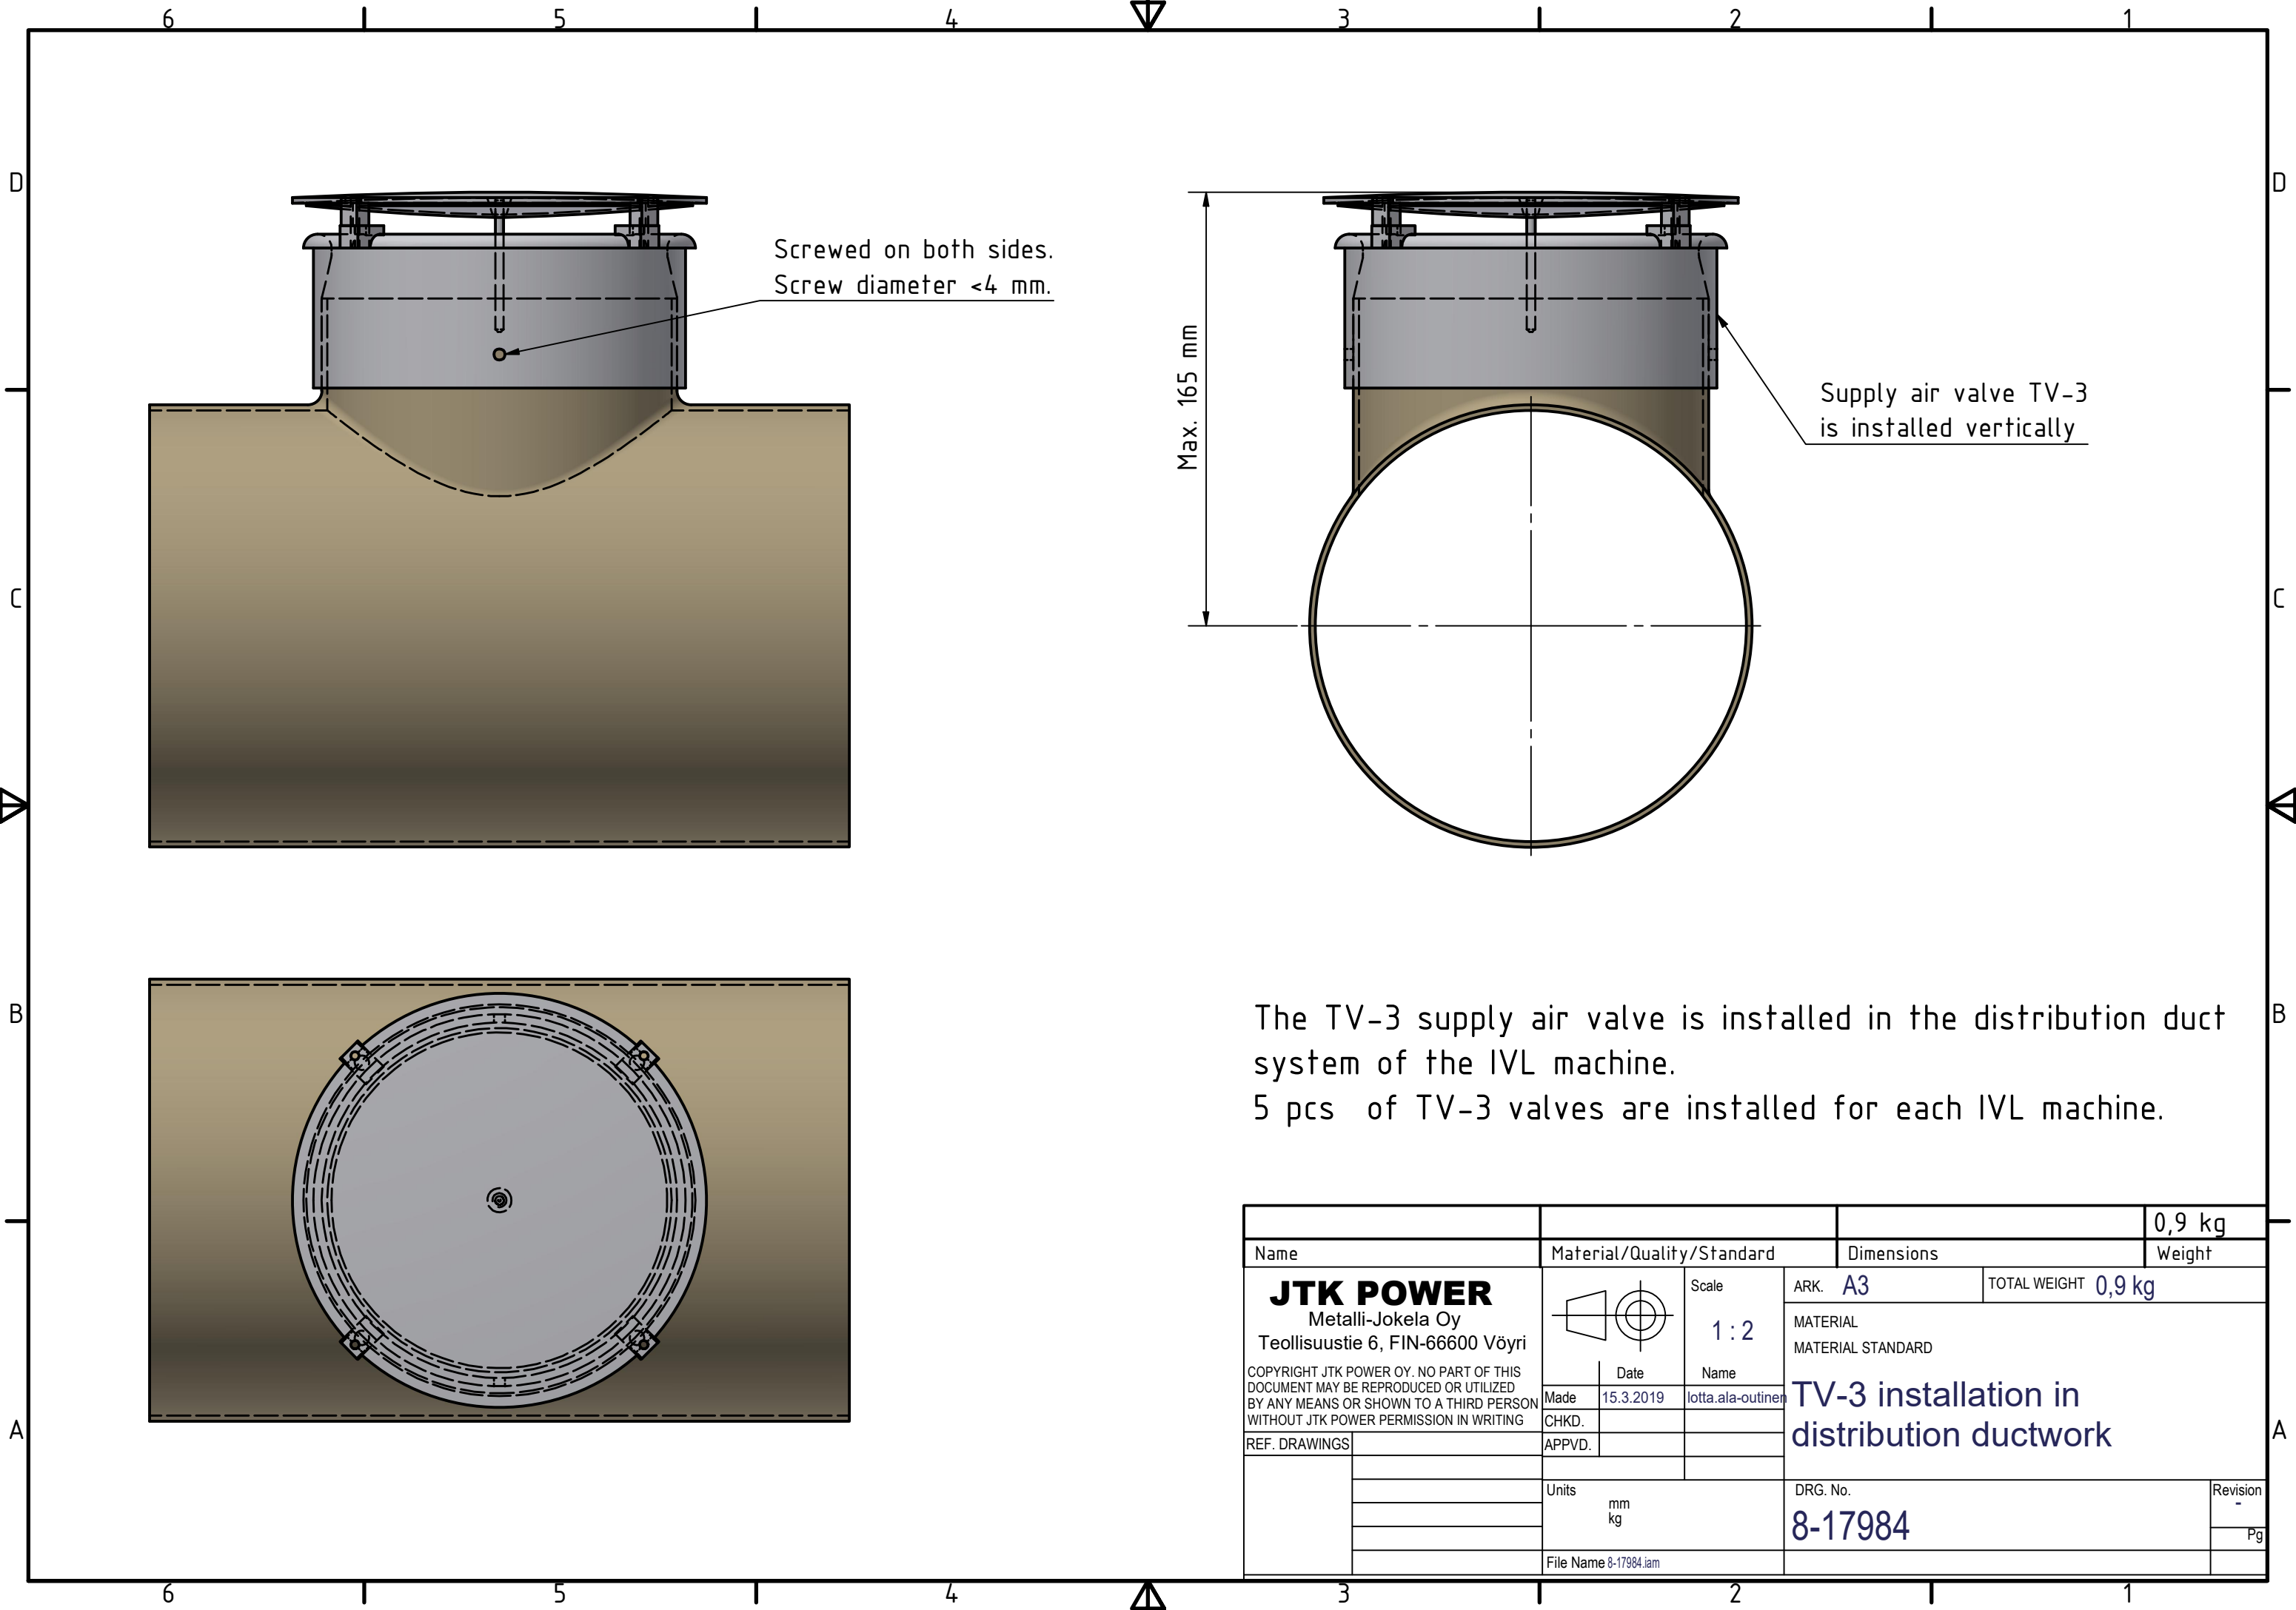




The TV-3 supply air valve is installed in the distribution duct system of the IVL machine.
5 pcs of TV-3 valves are installed for each IVL machine.

				0,9 kg
Name	Material/Quality/Standard		Dimensions	Weight
JTK POWER Metalli-Jokela Oy Teollisuustie 6, FIN-66600 Vöyri COPYRIGHT JTK POWER OY. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR UTILIZED BY ANY MEANS OR SHOWN TO A THIRD PERSON WITHOUT JTK POWER PERMISSION IN WRITING		Scale	ARK. A3	TOTAL WEIGHT 0,9 kg
		1 : 2	MATERIAL MATERIAL STANDARD TV-3 installation in distribution ductwork	
	Date	Name		
	Made 15.3.2019	lotta.ala-outinen		
CHKD.			DRG. No. 8-17984	
REF. DRAWINGS	APPVD.			
		Units	Revision	
		mm	Pg	
		kg		
		File Name 8-17984.iam		